



Issued Date	5/11/2023	Transmit #	
Issued By	dschoeck	Issued Rev	

TYPICAL MOTOR PERFORMANCE DATA

Model: 0102XPEA44A-P

HP	kW	Pole	FL RPM	Frame	Voltage	Hz	Phase	FL Amps
10	7.5	2	3510	215TC	230/460	60	3	23.6/11.8
Enclosure	IP	Ins. Class	S.F.	Duty	NEMA Nom. Eff.	NEMA Design	kVA Code	Ambient (°C)
TEFC	56	F	1.15	CONT	90.2	В		40 C

Load	UD	kW	Amperes	Efficiency (%)	Power Factor (%)
Load	HP	KVV	Amperes	Efficiency (78)	` '
Full Load	10.00	7.5	11.8	90.2	88.2
¾ Load	7.50	5.6	9.0	91.1	87.2
∕₂ Load	5.00	3.7	6.7	89.2	81.2
√₄ Load	2.50	1.9	4.8	81.0	60.2
No Load			3.6		
Locked Rotor			80		43.5

Torque							
Full Load	Locked Rotor	Pull Up	Break Down	Inertia			
(lb-ft)	(% FLT)	(% FLT)	(% FLT)	(lb-ft²)			
15.0	265	235	355	0.62			

Safe Stall	Time(s)	Sound	Bearings*		Approx. Motor Weight
Cold	Hot	Pressure			Approx. Motor Weight
Colu	1100	dB(A) @ 1M	DE	NDE	(lbs)
35	15	-	6308UU	6308UU	

*Bearings are the only recommended spare part(s).

Motor Options: Product Family:EQP Global Explosion Proof Mounting:C-Face Round,Shaft:T Shaft

Customer	
Customer PO	
Sales Order	
Project #	

Tag:

TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.								
Engineering	aacosta	Doc. Written By	D. Suarez	Doc.# / Rev	MPCF-1119 / 0			
Engr. Date	4/27/2012	Doc. Approved By	M. Campbell	Doc. Issued	6/8/2011			



Issued Date	5/11/2023	Transmit #	
Issued By	dschoeck	Issued Rev	

TYPICAL MOTOR PERFORMANCE DATA

Model: 0102XPEA44A-P

HP	kW	Pole	FL RPM	Frame	Voltage	Hz	Phase	FL Amps
10	7.5	2	2880	215TC	190/380	50	3	28.8/14.4
Enclosure	IP	Ins. Class	S.F.	Duty	NEMA Nom. Eff.	NEMA Design	kVA Code	Ambient (°C)
TEFC	56	F	1.0	CONT	88.5	В		40 C

Load	HP	kW	Amperes	Efficiency (%)	Power Factor (%)
Full Load	10.00	7.5	14.4	91.2	88.0
¼ Load	7.50	5.6	11.1	92.1	85.9
∕₂ Load	5.00	3.7	7.9	91.9	80.0
4 Load	2.50	1.9	5.2	80.1	67.4
No Load			3.2		
Locked Rotor			100		39.8

Torque							
Full Load	Locked Rotor	Pull Up	Break Down	Inertia			
(lb-ft)	(% FLT)	(% FLT)	(% FLT)	(lb-ft²)			
18.2	185	165	235	0.62			

Safe Stall	Time(s)	Sound	Bearings*		Approx. Motor Weight	
Cold	Hot	Pressure				
Colu	1100	dB(A) @ 1M	DE	NDE	(lbs)	
15	6	-	6308UU	6308UU		

*Bearings are the only recommended spare part(s).

Motor Options: Product Family:EQP Global Explosion Proof Mounting:C-Face Round,Shaft:T Shaft

Customer	
Customer PO]
Sales Order]
Project #	1

Tag:

TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.							
Engineering	jhock	Doc. Written By	D. Suarez	Doc.# / Rev	MPCF-1119 / 0		
Engr. Date	4/9/2014	Doc. Approved By	M. Campbell	Doc. Issued	6/8/2011		




Issued Date	5/11/2023	Transmit #	
Issued By	dschoeck	Issued Rev	

SPEED TORQUE/CURRENT CURVE

Model: 0102XPEA44A-P

HP	kW	Pole	FL RPM	Frame	Voltage	Hz	Phase	FL Amps
10	7.5	2	3510	215TC	230/460	60	3	23.6/11.8
Enclosure	IP	Ins. Class	S.F.	Duty	NEMA Nom. Eff.	NEMA Design	kVA Code	Ambient (°C)
TEFC	56	F	1.15	CONT	90.2	В		40 C
Locked Rotor	Rotor wk ²		Torque					
Amps	Inertia	Full Load	Locked	Rotor	Pull Up)	Break	Down
Allips	(lb-ft²)	(lb-ft)	(%	6)	(%)		(%	6)
80	0.62	15.0	26	5	235		35	5

Design Values

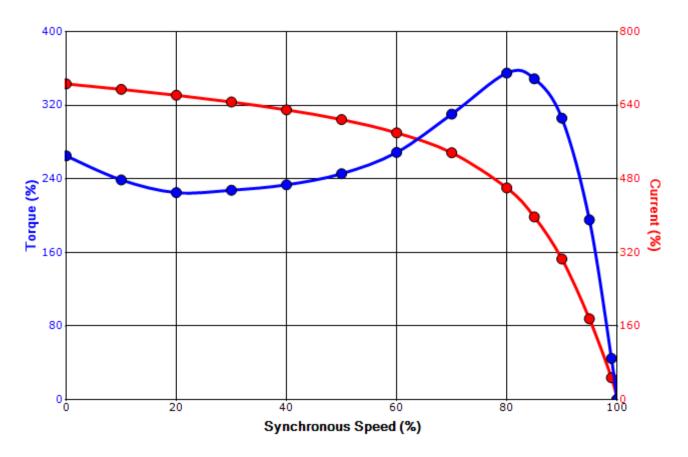



Customer	wk² Load Inertia (lb-	t²) -
Customer PO	Load Ty	pe -
Sales Order	Voltage (%) 100
Project #	Accel. Tir	ne -

Tag:

TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.							
Engineering	aacosta	Doc. Written By	D. Suarez	Doc.#/Rev	MPCF-1121 / 0		
Engr. Date	4/27/2012	Doc. Approved By	M. Campbell	Doc. Issued	6/8/2011		




Issued Date	5/11/2023	Transmit #	
Issued By	dschoeck	Issued Rev	

SPEED TORQUE/CURRENT CURVE

Model: 0102XPEA44A-P

HP	kW	Pole	FL RPM	Frame	Voltage	Hz	Phase	FL Amps
10	7.5	2	2880	215TC	190/380	50	3	28.8/14.4
Enclosure	IP	Ins. Class	S.F.	Duty	NEMA Nom. Eff.	NEMA Design	kVA Code	Ambient (°C)
TEFC	56	F	1.0	CONT	88.5	В		40 C
Laskad Datas	Rotor wk ²		Torque					
Locked Rotor Amps	Inertia	Full Load	Locked	Rotor	Pull Up)	Break	Down
Allips	(lb-ft²)	(lb-ft)	(%	6)	(%)		(%	6)
100	0.62	18.2	185		165		23	5

Design Values

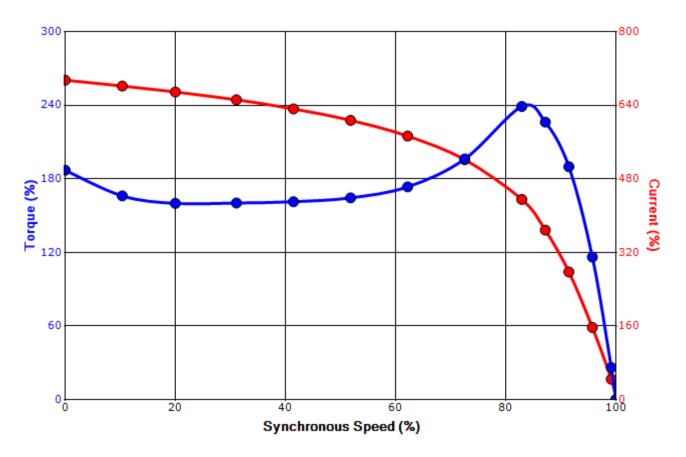



Customer	wk² Load Inertia (lb-ft²)	-
Customer PO	Load Type	-
Sales Order	Voltage (%)	100
Project #	Accel. Time	-


Tag:

TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.							
Engineering	jhock	Doc. Written By	D. Suarez	Doc.# / Rev	MPCF-1121 / 0		
Engr. Date	4/9/2014	Doc. Approved By	M. Campbell	Doc. Issued	6/8/2011		


Motor Connection Diagrams 12 Leads

Across-the-Line Starting / Running Connections

Low Voltage Delta

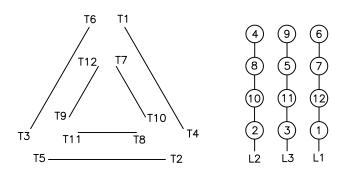

High Voltage Delta

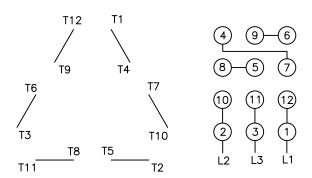

Switch L1 and L2 to reverse rotation

Suitable for Wye-Delta Starting and Limited Part-Winding-Starting. Please Contact Toshiba International for specific connections.

By: R. Murillo Date: 4/9/08 Checked: MDC Date: 5/17/11 Revision 1