

| | | |
|-----------------------------------------|-----------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| UNITS: INCHES | | NOTES: 1. MAIN CONDUIT BOX MAY BE ROTATED IN 90° INCREMENTS 2. STANDARD PRODUCT USES BI-DIRECTIONAL FAN. OPPOSITE ROTATION AVAILABLE ONLY BY CONNECTION CHANGE. 3. KEY DIMENSIONS EQUAL 0.312"x 0.312"x 2.38" (MOTOR SUPPLIED WITH KEY) |
| ROTATION FROM NDE | | |
| <input checked="" type="checkbox"/> CCW | <input type="checkbox"/> CW | |

TOSHIBA RESERVES THE RIGHT TO MAKE CHANGES OF TECHNICAL IMPROVEMENT AND THE DATA MAY CHANGE WITHOUT NOTICE PRELIMINARY

DO NOT USE FOR CONSTRUCTION, INSTALLATION, OR APPLICATION PURPOSES UNLESS THE DRAWING IS MARKED AS CERTIFIED CERTIFIED

TOSHIBA
www.toshiba.com/tic
TOSHIBA INTERNATIONAL CORPORATION

SEVERE DUTY
EQP **SD**

TOTALLY ENCLOSED FAN COOLED
HORIZONTAL FOOT MOUNTED
3 PHASE INDUCTION MOTOR
213T-215T F1 ASSEMBLY

DRAWING #: MDSL001-03
REV. DATE: 06/26/18 REV. #: 1 PER.: M. O'DOWD
REV. DESCRIP.:



| | | | |
|-------------|------------|------------|--|
| Issued Date | 12/18/2019 | Transmit # | |
| Issued By | dschoeck | Issued Rev | |

TYPICAL MOTOR PERFORMANCE DATA

Model: 0104SDSR41A-P

| | | | | | | | | |
|-----------|-----|------------|--------|-------|----------------|-------------|----------|--------------|
| HP | kW | Pole | FL RPM | Frame | Voltage | Hz | Phase | FL Amps |
| 10 | 7.5 | 4 | 1760 | 215T | 230/460 | 60 | 3 | 26/12.8 |
| Enclosure | IP | Ins. Class | S.F. | Duty | NEMA Nom. Eff. | NEMA Design | kVA Code | Ambient (°C) |
| TEFC | 55 | F | 1.15 | CONT | 91.7 | B | H | 40 C |

| | | | | | |
|--------------|------|-----|---------|----------------|------------------|
| Load | HP | kW | Amperes | Efficiency (%) | Power Factor (%) |
| Full Load | 10 | 7.5 | 12.7 | 91.6 | 80.2 |
| ¾ Load | 7.50 | 5.6 | 10.1 | 91.0 | 76.2 |
| ½ Load | 5.00 | 3.7 | 7.8 | 88.9 | 67.1 |
| ¼ Load | 2.50 | 1.9 | 6.1 | 81.7 | 46.3 |
| No Load | | | 5.7 | | 6.0 |
| Locked Rotor | | | 81 | | 45.7 |

| | | | | |
|-------------------|----------------------|-----------------|--------------------|-----------------------------------------------------|
| Torque | | | | Rotor wk ² Inertia (lb-ft ²) |
| Full Load (lb-ft) | Locked Rotor (% FLT) | Pull Up (% FLT) | Break Down (% FLT) | |
| 29.8 | 260 | 225 | 330 | 1.34 |

| | | | | | |
|--------------------|-----|---------------------------|-----------|---------|----------------------------|
| Safe Stall Time(s) | | Sound Pressure dB(A) @ 1M | Bearings* | | Approx. Motor Weight (lbs) |
| Cold | Hot | | DE | NDE | |
| 35 | 15 | - | 6308ZC3 | 6308ZC3 | 203 |

*Bearings are the only recommended spare part(s).

Motor Options:
 Product Family:EQP Global SD
 Mounting:Footed,Shaft:T Shaft

| | |
|-------------|--|
| Customer | |
| Customer PO | |
| Sales Order | |
| Project # | |

Tag:

All characteristics are average expected values.

TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.

| | | | | | |
|-------------|-----------|------------------|-------------|-------------|---------------|
| Engineering | bammen | Doc. Written By | D. Suarez | Doc.# / Rev | MPCF-1119 / 1 |
| Engr. Date | 8/22/2019 | Doc. Approved By | M. Campbell | Doc. Issued | 9/20/2019 |



| | | | |
|-------------|------------|------------|--|
| Issued Date | 12/18/2019 | Transmit # | |
| Issued By | dschoeck | Issued Rev | |

TYPICAL MOTOR PERFORMANCE DATA

Model: 0104SDSR41A-P

| | | | | | | | | |
|-----------|-----|------------|--------|-------|----------------|-------------|----------|--------------|
| HP | kW | Pole | FL RPM | Frame | Voltage | Hz | Phase | FL Amps |
| 10 | 7.5 | 4 | 1450 | 215T | 190/380 | 50 | 3 | 31/15.5 |
| Enclosure | IP | Ins. Class | S.F. | Duty | NEMA Nom. Eff. | NEMA Design | kVA Code | Ambient (°C) |
| TEFC | 55 | F | 1.0 | CONT | 89.5 | B | H | 40 C |

| | | | | | |
|--------------|------|-----|---------|----------------|------------------|
| Load | HP | kW | Amperes | Efficiency (%) | Power Factor (%) |
| Full Load | 10 | 7.5 | 15.5 | 91.6 | 79.5 |
| ¾ Load | 7.50 | 5.6 | 11.7 | 92.1 | 75.7 |
| ½ Load | 5.00 | 3.7 | 8.6 | 91.5 | 66.9 |
| ¼ Load | 2.50 | 1.9 | 5.5 | 83.6 | 61.1 |
| No Load | | | 5.5 | | 5.5 |
| Locked Rotor | | | 100 | | 44.7 |

| | | | | |
|-------------------|----------------------|-----------------|--------------------|-----------------------------------------------------|
| Torque | | | | Rotor wk ² Inertia (lb-ft ²) |
| Full Load (lb-ft) | Locked Rotor (% FLT) | Pull Up (% FLT) | Break Down (% FLT) | |
| 36.2 | 200 | 180 | 250 | 1.34 |

| | | | | | |
|--------------------|-----|---------------------------|-----------|---------|----------------------------|
| Safe Stall Time(s) | | Sound Pressure dB(A) @ 1M | Bearings* | | Approx. Motor Weight (lbs) |
| Cold | Hot | | DE | NDE | |
| 26 | 14 | - | 6308ZC3 | 6308ZC3 | 203 |

*Bearings are the only recommended spare part(s).

Motor Options:
 Product Family:EQP Global SD
 Mounting:Footed,Shaft:T Shaft

| | |
|-------------|--|
| Customer | |
| Customer PO | |
| Sales Order | |
| Project # | |

Tag:

All characteristics are average expected values.

TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.

| | | | | | |
|-------------|----------|------------------|-------------|-------------|---------------|
| Engineering | jhock | Doc. Written By | D. Suarez | Doc.# / Rev | MPCF-1119 / 1 |
| Engr. Date | 4/9/2014 | Doc. Approved By | M. Campbell | Doc. Issued | 9/20/2019 |




| | | | |
|-------------|------------|------------|--|
| Issued Date | 12/18/2019 | Transmit # | |
| Issued By | dschoeck | Issued Rev | |

SPEED TORQUE/CURRENT CURVE

Model: 0104SDSR41A-P

| | | | | | | | | |
|-------------------|-----------------------------------------------------|-------------------|------------------|-------------|----------------|-------------|----------|--------------|
| HP | kW | Pole | FL RPM | Frame | Voltage | Hz | Phase | FL Amps |
| 10 | 7.5 | 4 | 1760 | 215T | 230/460 | 60 | 3 | 26/12.8 |
| Enclosure | IP | Ins. Class | S.F. | Duty | NEMA Nom. Eff. | NEMA Design | kVA Code | Ambient (°C) |
| TEFC | 55 | F | 1.15 | CONT | 91.7 | B | H | 40 C |
| Locked Rotor Amps | Rotor wk ² Inertia (lb-ft ²) | Torque | | | | | | |
| | | Full Load (lb-ft) | Locked Rotor (%) | Pull Up (%) | Break Down (%) | | | |
| 81 | 1.34 | 29.8 | 260 | 225 | 330 | | | |

Design Values

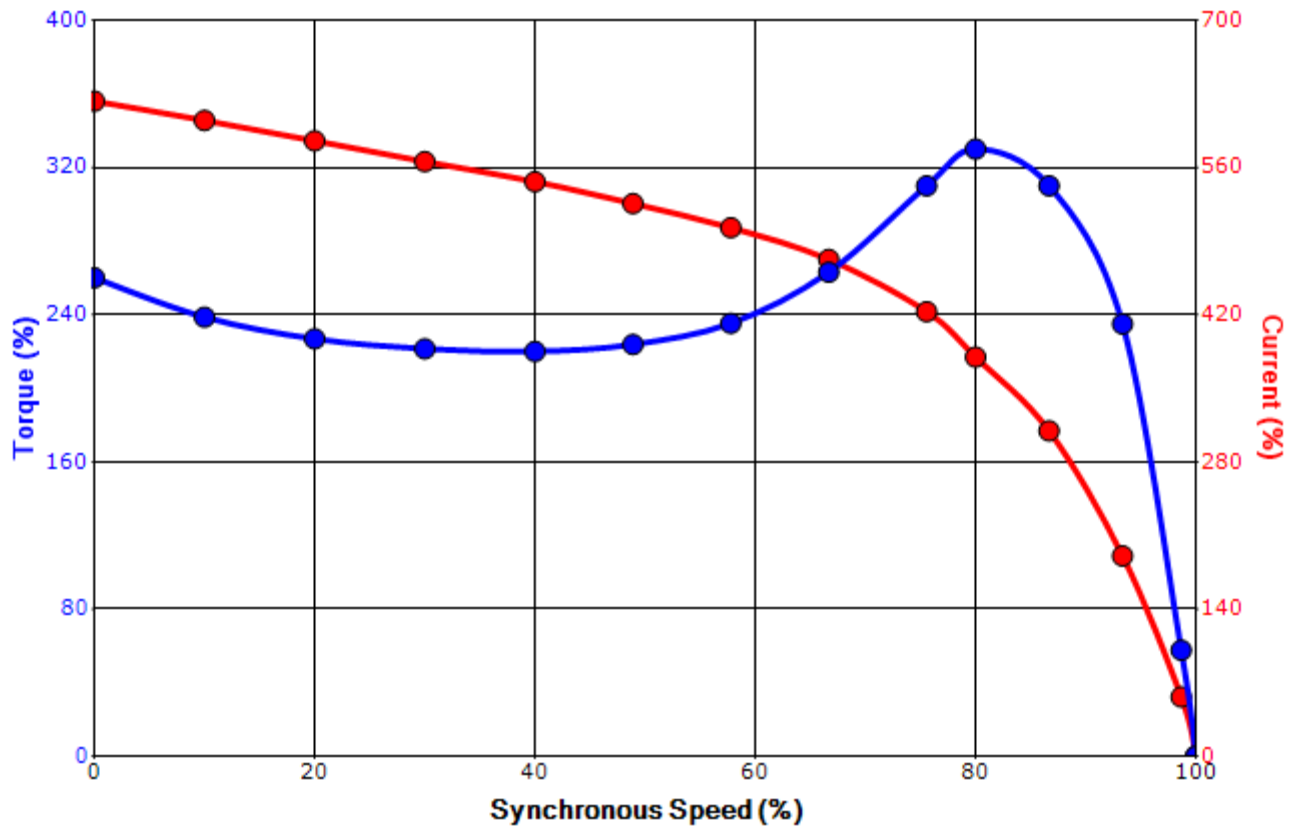

| | | | |
|-------------|--|----------------------------------------------------|-----|
| Customer | | wk ² Load Inertia (lb-ft ²) | - |
| Customer PO | | Load Type | - |
| Sales Order | | Voltage (%) | 100 |
| Project # | | Accel. Time | - |

Tag:

All characteristics are average expected values.

TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.

| | | | | | |
|-------------|-----------|------------------|-------------|-------------|-------------|
| Engineering | bmammen | Doc. Written By | D. Suarez | Doc.# / Rev | MPCF-1121/1 |
| Engr. Date | 8/22/2019 | Doc. Approved By | M. Campbell | Doc. Issued | 9/20/2019 |




| | | | |
|-------------|------------|------------|--|
| Issued Date | 12/18/2019 | Transmit # | |
| Issued By | dschoeck | Issued Rev | |

SPEED TORQUE/CURRENT CURVE

Model: 0104SDSR41A-P

| | | | | | | | | |
|-------------------|-----------------------------------------------------|-------------------|------------------|-------|----------------|-------------|----------------|--------------|
| HP | kW | Pole | FL RPM | Frame | Voltage | Hz | Phase | FL Amps |
| 10 | 7.5 | 4 | 1450 | 215T | 190/380 | 50 | 3 | 31/15.5 |
| Enclosure | IP | Ins. Class | S.F. | Duty | NEMA Nom. Eff. | NEMA Design | kVA Code | Ambient (°C) |
| TEFC | 55 | F | 1.0 | CONT | 89.5 | B | H | 40 C |
| Locked Rotor Amps | Rotor wk ² Inertia (lb-ft ²) | Torque | | | | Pull Up (%) | Break Down (%) | |
| | | Full Load (lb-ft) | Locked Rotor (%) | | | | | |
| 100 | 1.34 | 36.2 | 200 | | 180 | 250 | | |

Design Values

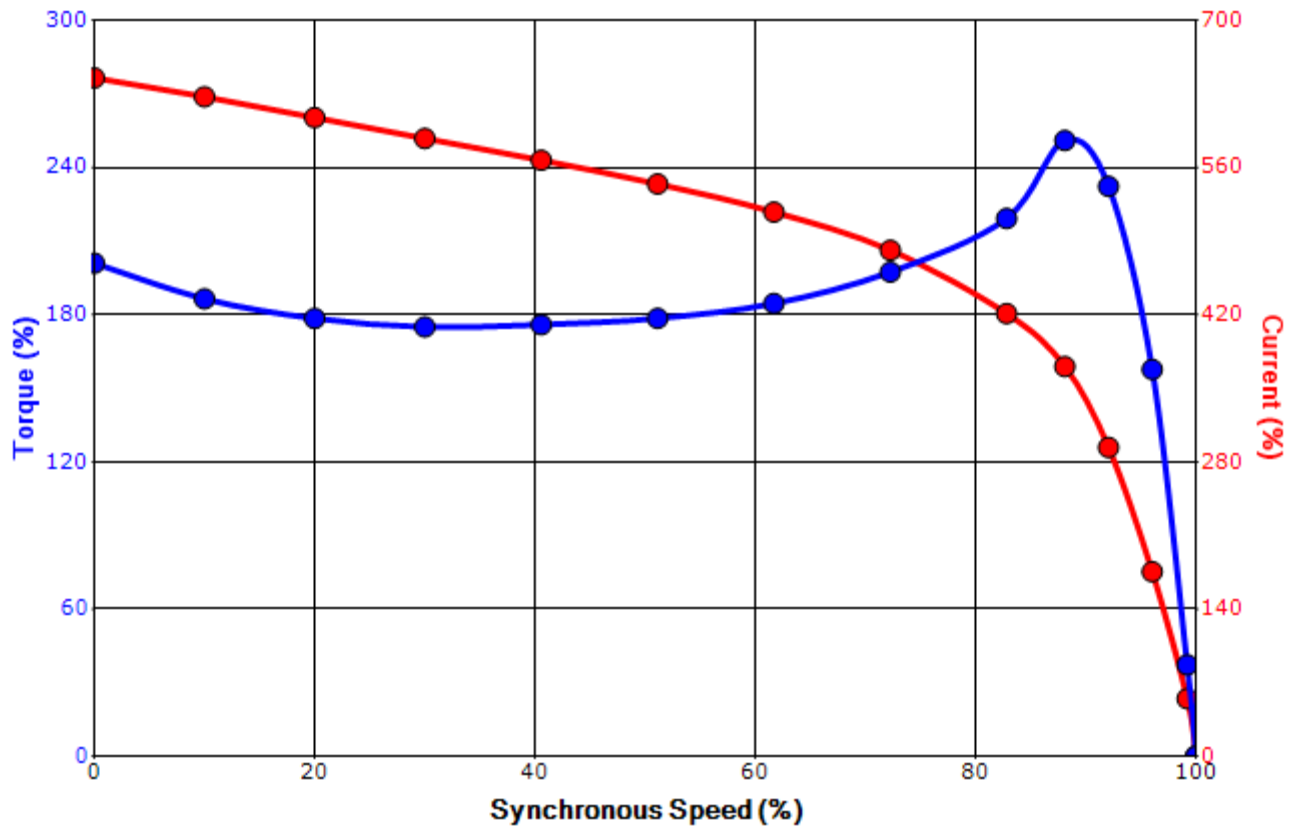

| | | | |
|-------------|--|----------------------------------------------------|-----|
| Customer | | wk ² Load Inertia (lb-ft ²) | - |
| Customer PO | | Load Type | - |
| Sales Order | | Voltage (%) | 100 |
| Project # | | Accel. Time | - |

Tag:

All characteristics are average expected values.


TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.

| | | | | | |
|-------------|----------|------------------|-------------|-------------|-------------|
| Engineering | jhock | Doc. Written By | D. Suarez | Doc.# / Rev | MPCF-1121/1 |
| Engr. Date | 4/9/2014 | Doc. Approved By | M. Campbell | Doc. Issued | 9/20/2019 |


Motor Connection Diagrams
12 Leads

Across-the-Line Starting / Running Connections

Low Voltage Delta

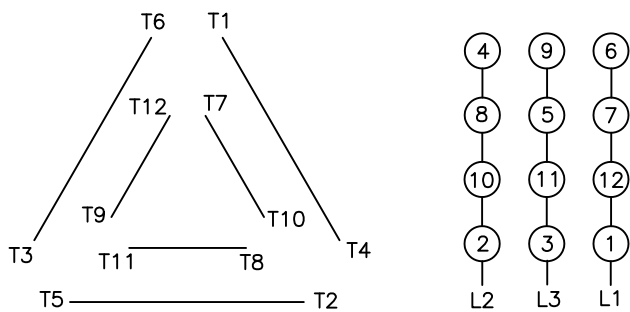

High Voltage Delta

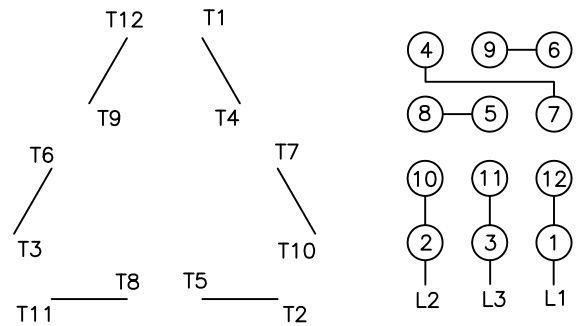

Switch L1 and L2 to reverse rotation

Suitable for Wye-Delta Starting and Limited Part-Winding-Starting.
Please Contact Toshiba International for specific connections.