



# TORQUE AND CURRENT VS SPEED CURVE

## Three Phase Induction Motor - Squirrel Cage




Customer :

Product line : NEMA Premium Efficiency Three-Phase

Product code : 12792613

Catalog # : 02018OT3H256T-SG

TORQUE AND CURRENT VS SPEED CURVE

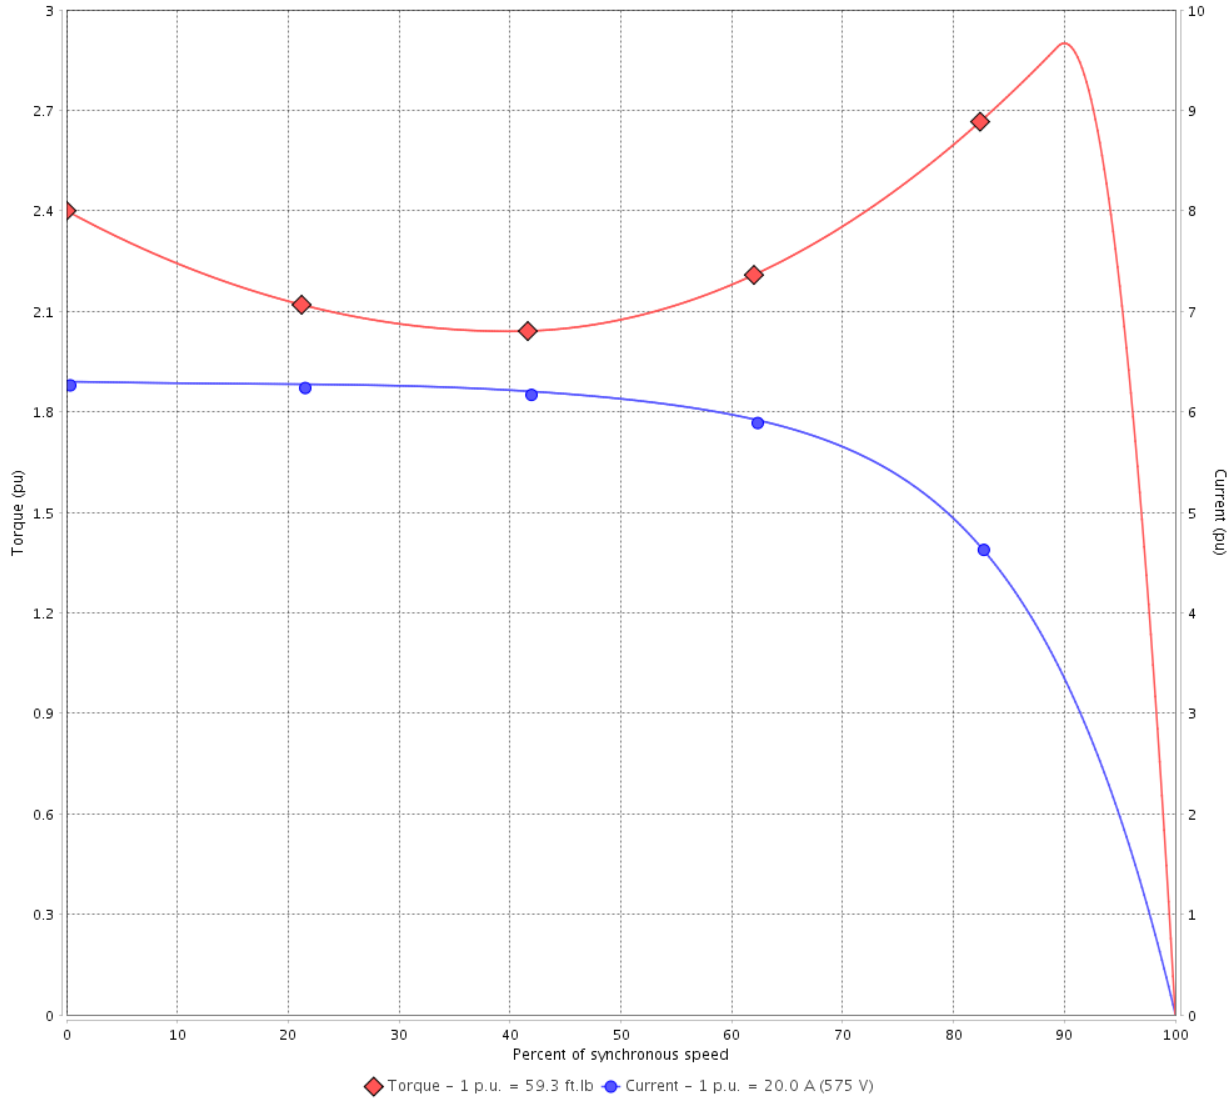

Performance : 575 V 60 Hz 4P

Rated current	: 20.0 A	Moment of inertia (J)	: 2.23 sq.ft.lb
LRC	: 6.3	Duty cycle	: Cont.(S1)
Rated torque	: 59.3 ft.lb	Insulation class	: F
Locked rotor torque	: 240 %	Service factor	: 1.15
Breakdown torque	: 290 %	Temperature rise	: 80 K
Rated speed	: 1770 rpm	Design	: B

Locked rotor time : 27s (cold) 15s (hot)

Rev.	Changes Summary	Performed	Checked	Date
Performed by			Page 2 / 6	Revision
Checked by				
Date	14/04/2022			

# LOAD PERFORMANCE CURVE

## Three Phase Induction Motor - Squirrel Cage




Customer : \_\_\_\_\_

Product line : NEMA Premium Efficiency Three-Phase

Product code : 12792613

Catalog # : 02018OT3H256T-SG

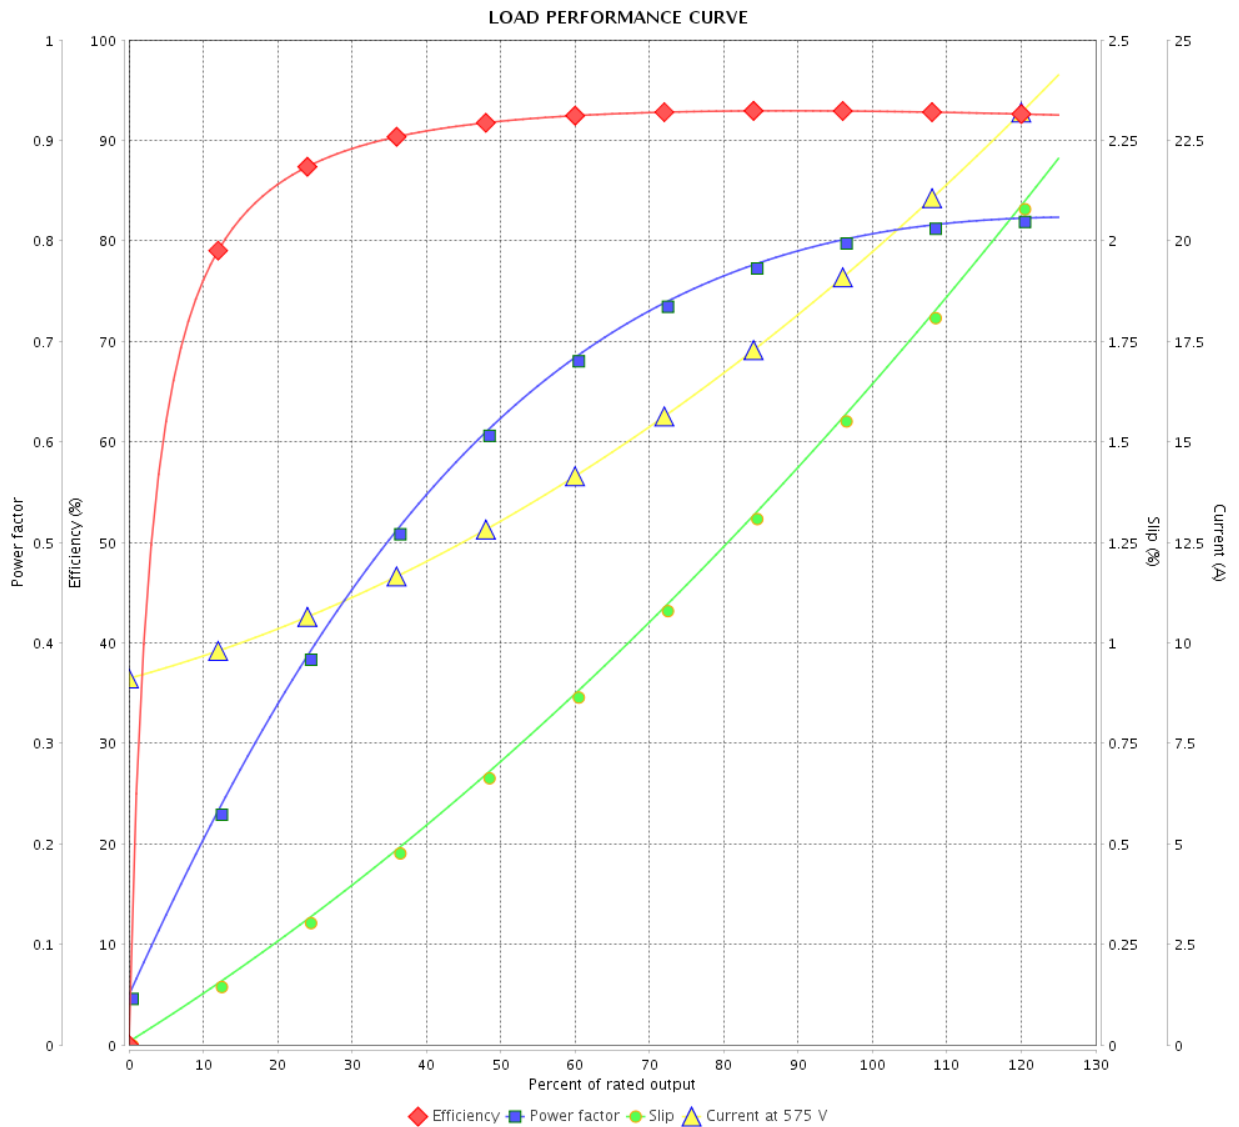

Performance : 575 V 60 Hz 4P

Rated current : 20.0 A  
 LRC : 6.3  
 Rated torque : 59.3 ft.lb  
 Locked rotor torque : 240 %  
 Breakdown torque : 290 %  
 Rated speed : 1770 rpm

Moment of inertia (J) : 2.23 sq.ft.lb  
 Duty cycle : Cont.(S1)  
 Insulation class : F  
 Service factor : 1.15  
 Temperature rise : 80 K  
 Design : B

Rev.	Changes Summary	Performed	Checked	Date
Performed by			Page	Revision
Checked by				
Date				
			3 / 6	

# THERMAL LIMIT CURVE

## Three Phase Induction Motor - Squirrel Cage



Customer :

Product line : NEMA Premium Efficiency Three-Phase  
Product code : 12792613  
Catalog # : 02018OT3H256T-SG

Performance : 575 V 60 Hz 4P

Rated current	: 20.0 A	Moment of inertia (J)	: 2.23 sq.ft.lb
LRC	: 6.3	Duty cycle	: Cont.(S1)
Rated torque	: 59.3 ft.lb	Insulation class	: F
Locked rotor torque	: 240 %	Service factor	: 1.15
Breakdown torque	: 290 %	Temperature rise	: 80 K
Rated speed	: 1770 rpm	Design	: B

Heating constant

Cooling constant


Rev.	Changes Summary	Performed	Checked	Date
Performed by				
Checked by			Page	Revision
Date	14/04/2022		4 / 6	

# THERMAL LIMIT CURVE

Three Phase Induction Motor - Squirrel Cage



Customer : \_\_\_\_\_

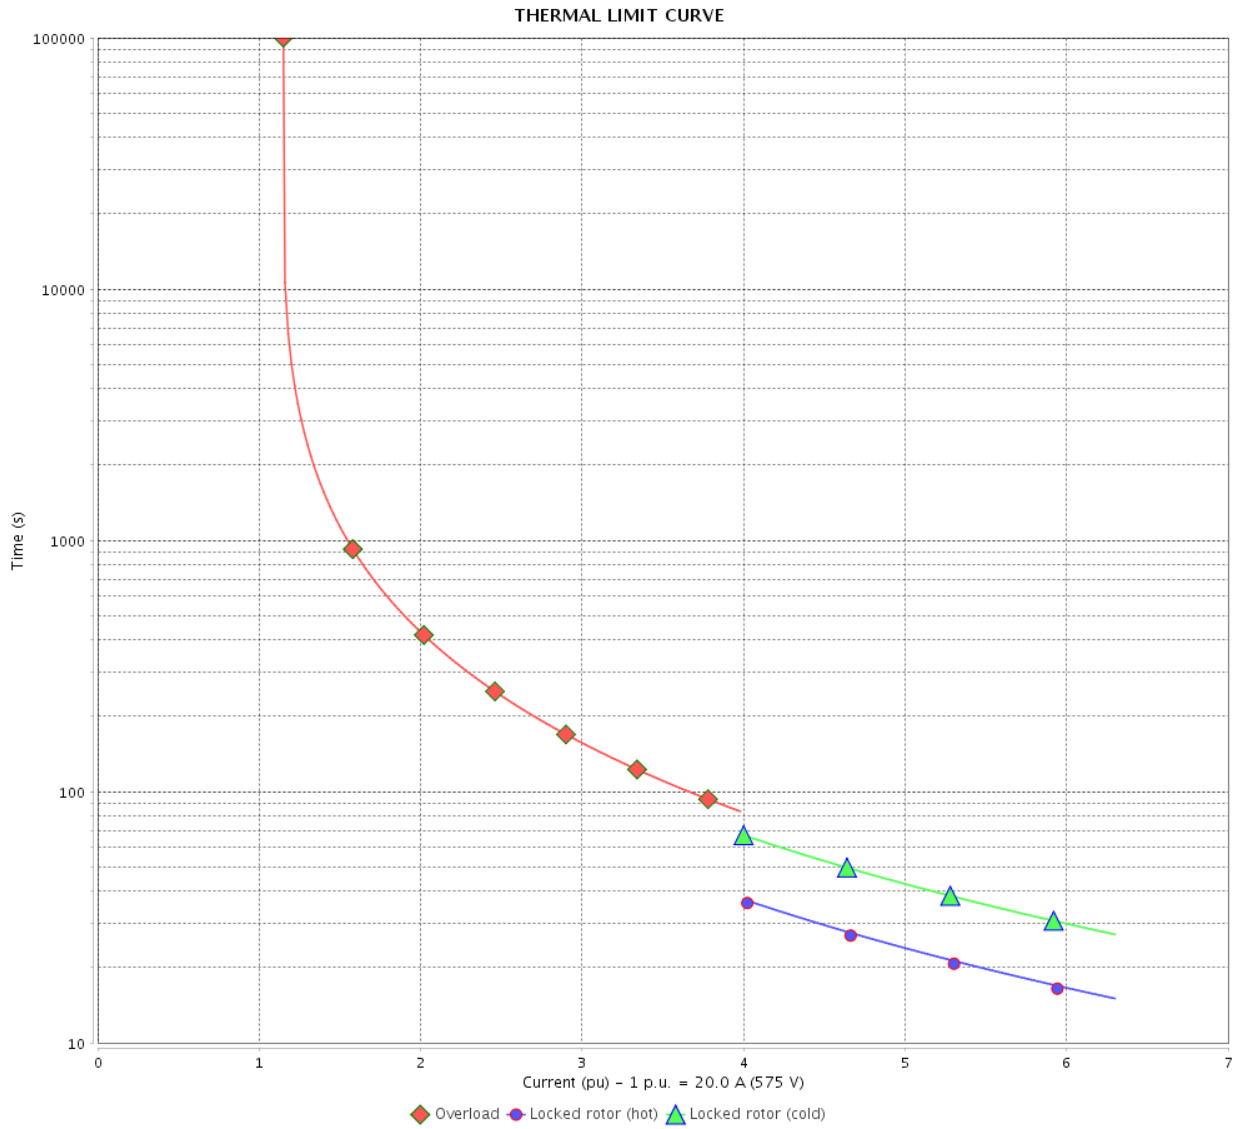

Rev.	Changes Summary	Performed	Checked	Date
Performed by		Page      Revision 5 / 6		
Checked by				
Date				

# VFD OPERATION CURVE

Three Phase Induction Motor - Squirrel Cage




Customer :

Product line : NEMA Premium Efficiency Three-Phase

Product code : 12792613

Catalog # : 02018OT3H256T-SG

VFD OPERATION CURVE

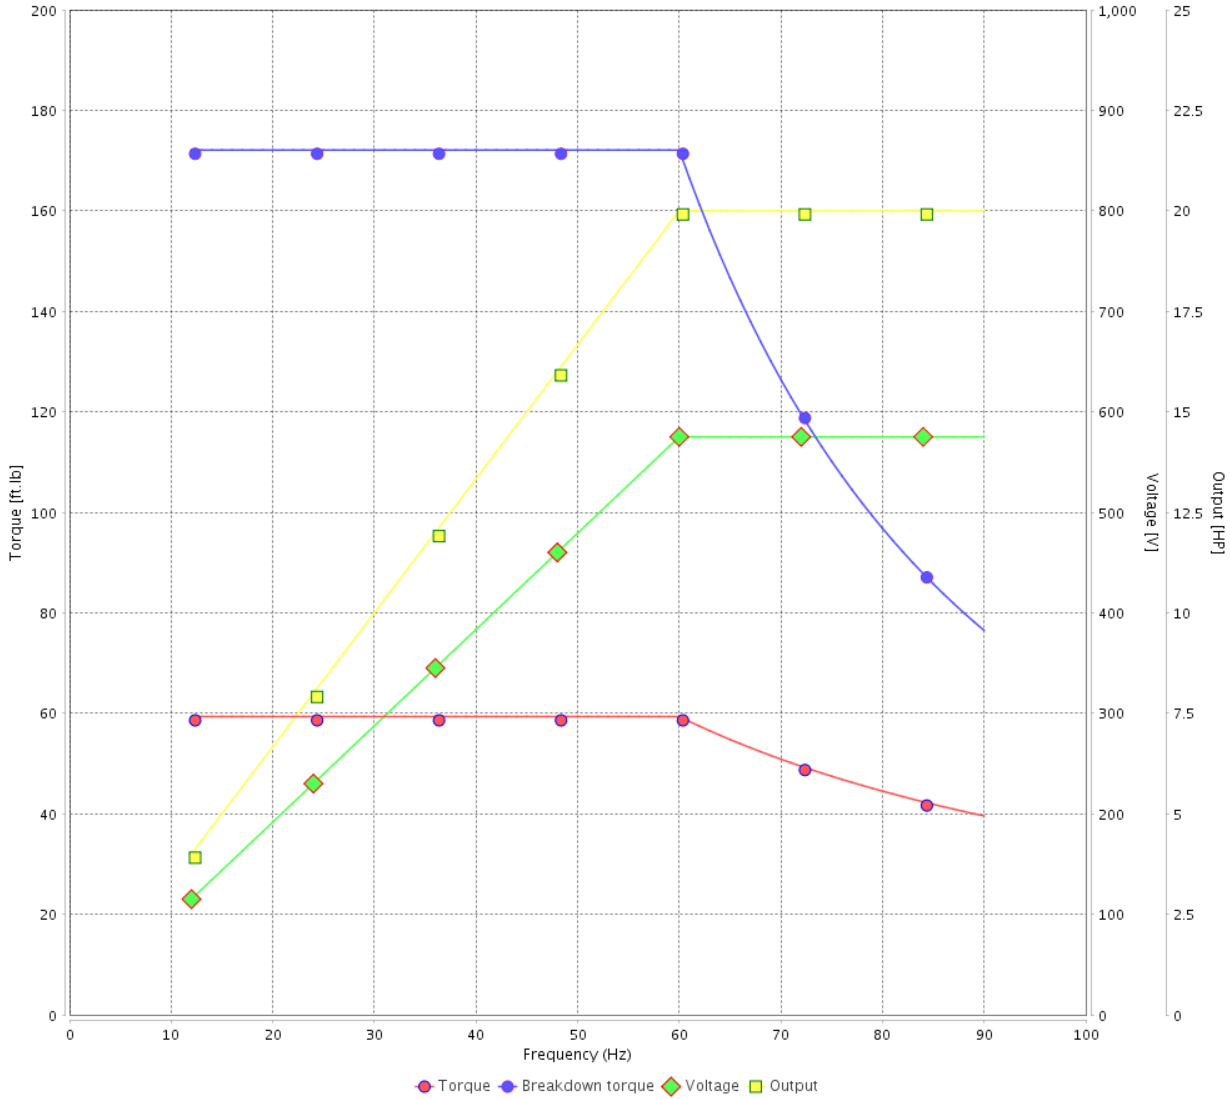


Performance : 575 V 60 Hz 4P



Rated current : 20.0 A  
 LRC : 6.3  
 Rated torque : 59.3 ft.lb  
 Locked rotor torque : 240 %  
 Breakdown torque : 290 %  
 Rated speed : 1770 rpm

Moment of inertia (J) : 2.23 sq.ft.lb  
 Duty cycle : Cont.(S1)  
 Insulation class : F  
 Service factor : 1.15  
 Temperature rise : 80 K  
 Design : B

Rev.	Changes Summary	Performed	Checked	Date
Performed by			Page 6 / 6	Revision
Checked by				
Date	14/04/2022			

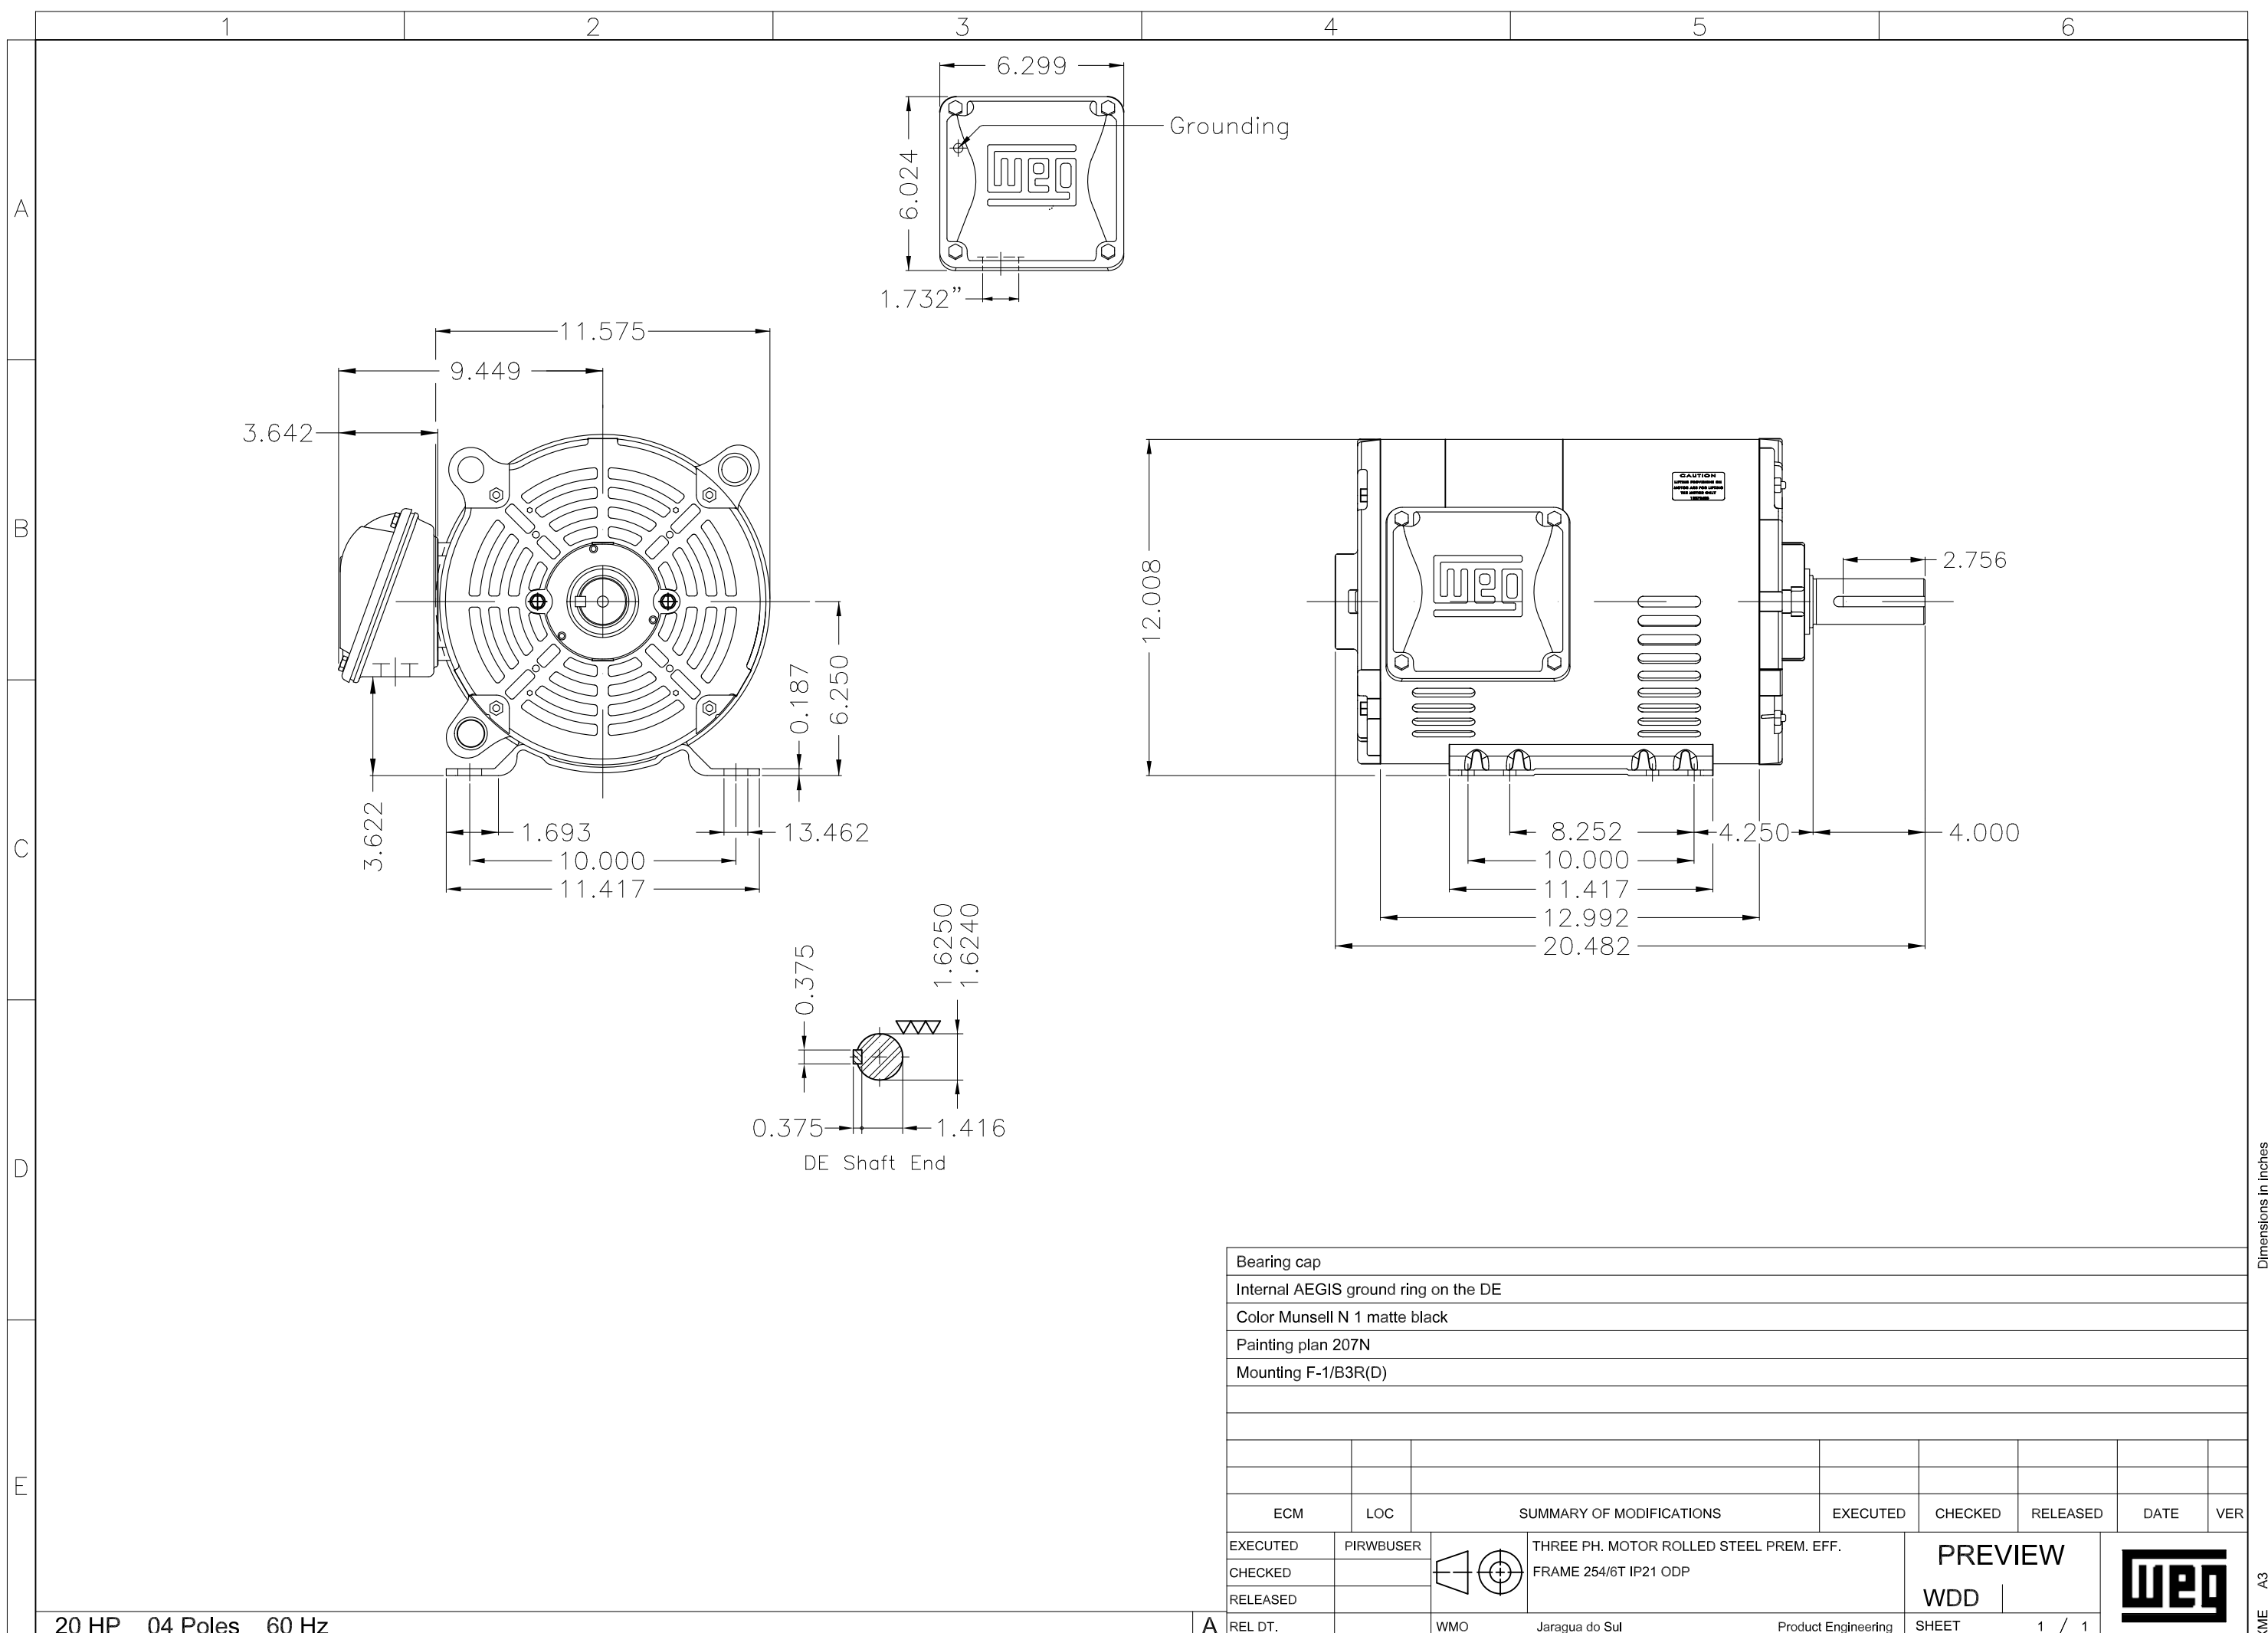

- Bearing cap
- Internal AEGIS ground ring on the DE
- Color Munsell N 1 matte black
- Painting plan 207N
- Mounting F-1/B3R(D)

ECM	LOC	SUMMARY OF MODIFICATIONS	EXECUTED	CHECKED	RELEASED	DATE	VER
EXECUTED	PIRWUSER	 THREE PH. MOTOR ROLLED STEEL PREM. EFF. FRAME 254/6T IP21 ODP					
CHECKED							
RELEASED							
REL DT.	WMO	Jaragua do Sul	Product Engineering	SHEET 1 / 1		PREVIEW WDD 	

20 HP 04 Poles 60 Hz

Dimensions in inches XME A3



**NEMA**  
**Premium**



3PT9



Energy Verified


MADE IN MEXICO

**MAT: 12792613 CC029A**  
**W01.T00IC0X0N**  
**DP020504NPW01GR**  
**19AUG2021 S/N:**

PH 3	Hz 60	HP 20
FR 254/6T		KW 15
DUTY CONT.		V 575
ALT 1000 m.a.s.l		A 20.0
INS CL F AT 80K		SFA 23.0
AMB 40°C	DES B	SF 1.15
ENCL ODP	CODE G	PF 0.81
		RPM 1770
		NEMA NOM. EFF 93.0%

Inverter duty motor For use on VPWM 1000:1 VT, 5:1 CT

DE 6309-Z-C3	ODE 6208-Z-C3	MOBIL POLYREX EM	20000h
--------------	---------------	------------------	--------



T1-BLU  
T2-WHT  
T3-ORG  
T4-YEL  
T5-BLK  
T6-GRY

**INTERCHANGE ANY TWO LINE WIRES TO REVERSE THE ROTATION**

**WARNING:** Motor must be grounded in accordance with local and national electrical codes to prevent serious electrical shocks. Disconnect power source before servicing unit.



**AVERTISSEMENT:** Le moteur doit être mis à la terre

conformément aux codes électriques locaux et nationaux afin d'éviter tout choc électrique grave. Déconnectez l'alimentation avant l'entretien de la machine.

