



Issued Date	7/19/2021	Transmit #	
Issued By	dschoeck	Issued Rev	

### **TYPICAL MOTOR PERFORMANCE DATA**

Model: Y752XPEA44A-P

HP	kW	Pole	FL RPM	Frame	Voltage	Hz	Phase	FL Amps
7.50	5.5	2	3500	213TC	230/460	60	3	18.0/9.0
Enclosure	IP	Ins. Class	S.F.	Duty	NEMA Nom. Eff.	NEMA Design	kVA Code	Ambient (°C)
TEFC	56	F	1.15	CONT	89.5	В		40 C

Load	HP	kW	Amperes	Efficiency (%)	Power Factor (%)
Full Load	7.50	5.6	9.0	90.1	88.5
4 Load	5.63	4.2	6.8	89.8	86.1
∕₂ Load	3.75	2.8	5.0	88.0	79.6
4 Load	1.88	1.4	3.5	80.6	60.7
lo Load			2.4		9.2
ocked Rotor			60		40.4

Torque							
Full Load	Locked Rotor	Pull Up	Break Down	Inertia			
(lb-ft)	(% FLT)	(% FLT)	(% FLT)	(lb-ft²)			
11.3	230	215	320	0.46			

Safe Stall	Time(s)	Sound	Pressure Bearings*		Approx. Motor Weight	
Cold	Hot					
Colu	1100	dB(A) @ 1M	DE	NDE	(lbs)	
19	11	-	6308UU	6308UU		

\*Bearings are the only recommended spare part(s).

Motor Options: Product Family:TEXP Mounting:C-Face Round,Shaft:T Shaft

Customer	
Customer PO	
Sales Order	
Project #	

Tag:

TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.								
Engineering	bmammen	Doc. Written By	D. Suarez	Doc.# / Rev	MPCF-1119 / 0			
Engr. Date	8/1/2017	Doc. Approved By	M. Campbell	Doc. Issued	6/8/2011			



Issued Date	7/19/2021	Transmit #	
Issued By	dschoeck	Issued Rev	

### **TYPICAL MOTOR PERFORMANCE DATA**

Model: Y752XPEA44A-P

HP	kW	Pole	FL RPM	Frame	Voltage	Hz	Phase	FL Amps
7.50	5.5	2	2860	213TC	190/380	50	3	22/11.0
Enclosure	IP	Ins. Class	S.F.	Duty	NEMA Nom. Eff.	NEMA Design	kVA Code	Ambient (°C)
TEFC	56	F	1.0	CONT	86.5	В		40 C

Load	HP	kW	Amperes	Efficiency (%)	Power Factor (%)	
Full Load	7.50	5.6	11.0	90.6	86.5	
¾ Load	5.63	4.2	8.3	91.3	84.4	
½ Load	3.75	2.8	5.8	90.8	78.5	
¼ Load	1.88	1.4	3.8	80.5	68.1	
No Load			2.4		8.4	
Locked Rotor			75		41.5	

Torque								
Full Load	Locked Rotor	Pull Up	Break Down	Inertia				
(lb-ft)	(% FLT)	(% FLT)	(% FLT)	(lb-ft²)				
13.8	155	145	215	0.46				

Safe Stall	Time(s)	Sound Bearings*			Approx. Motor Weight	
Cold	Hot	Pressure	Bearin	195	Approx. Motor Weight	
Colu	1100	dB(A) @ 1M	DE	NDE	(lbs)	
14	6	-	6308UU	6308UU		

\*Bearings are the only recommended spare part(s).

Motor Options: Product Family:TEXP Mounting:C-Face Round,Shaft:T Shaft

Customer	
Customer PO	
Sales Order	
Project #	

Tag:

TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.								
Engineering	jhock	Doc. Written By	D. Suarez	Doc.# / Rev	MPCF-1119 / 0			
Engr. Date	4/8/2014	Doc. Approved By	M. Campbell	Doc. Issued	6/8/2011			




Issued Date	7/19/2021	Transmit #	
Issued By	dschoeck	Issued Rev	

### SPEED TORQUE/CURRENT CURVE

Model: Y752XPEA44A-P

HP	kW	Pole	FL RPM	Frame	Voltage	Hz	Phase	FL Amps
7.50	5.5	2	3500	213TC	230/460	60	3	18.0/9.0
Enclosure	IP	Ins. Class	S.F.	Duty	NEMA Nom. Eff.	NEMA Design	kVA Code	Ambient (°C)
TEFC	56	F	1.15	CONT	89.5	В		40 C
Looked Deter	Rotor wk <sup>2</sup>				Torque			
Locked Rotor	Inertia	Full Load	Locked	Rotor	Pull Up	)	Break	Down
Amps	(lb-ft²)	(lb-ft)	(%	<b>6</b> )	(%)		(%	<b>6</b> )
60	0.46	11.3	23	0	215		32	0

## Design Values

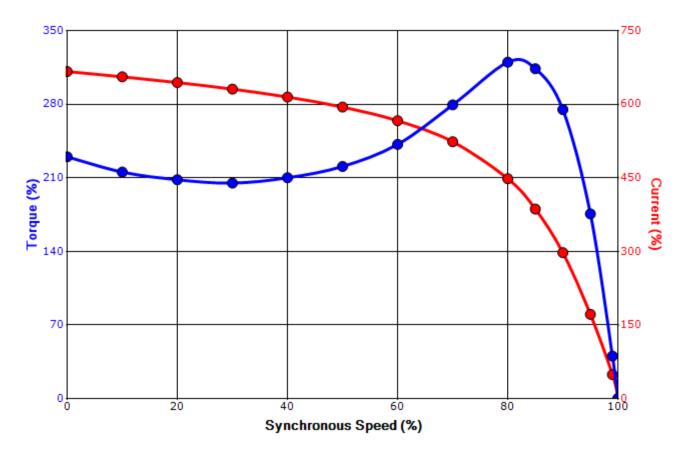



Customer	wk² Load Inertia (lb-	t²) -
Customer PO	Load Ty	pe -
Sales Order	Voltage (	<b>%)</b> 100
Project #	Accel. Tir	ne -

Tag:

TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.								
Engineering	bmammen	Doc. Written By	D. Suarez	Doc.# / Rev	MPCF-1121 / 0			
Engr. Date	8/1/2017	Doc. Approved By	M. Campbell	Doc. Issued	6/8/2011			




Issued Date	7/19/2021	Transmit #	
Issued By	dschoeck	Issued Rev	

### SPEED TORQUE/CURRENT CURVE

Model: Y752XPEA44A-P

HP	kW	Pole	FL RPM	Frame	Voltage	Hz	Phase	FL Amps
7.50	5.5	2	2860	213TC	190/380	50	3	22/11.0
Enclosure	IP	Ins. Class	S.F.	Duty	NEMA Nom. Eff.	NEMA Design	kVA Code	Ambient (°C)
TEFC	56	F	1.0	CONT	86.5	В		40 C
Laskad Datas	Rotor wk <sup>2</sup>				Torque			
Locked Rotor	Inertia	Full Load	Locked	Rotor	Pull Up	)	Break	Down
Amps	(lb-ft²)	(lb-ft)	(%	b)	(%)		(%	<b>6</b> )
75	0.46	13.8	155	5	145		21	5

## Design Values

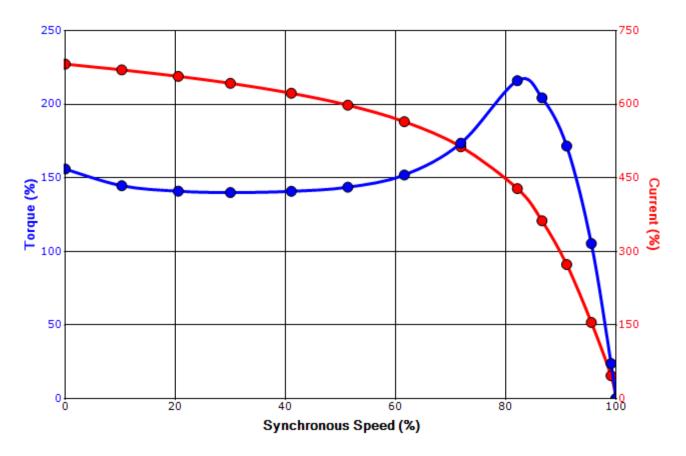



Customer	wk² Load Inertia (lb-	t²) -
Customer PO	Load Ty	pe -
Sales Order	Voltage (	<b>%)</b> 100
Project #	Accel. Tir	ne -


Tag:

TOSHIBA INTERNATIONAL CORPORATION · HOUSTON, TEXAS U.S.A.							
Engineering	jhock	Doc. Written By	D. Suarez	Doc.#/Rev	MPCF-1121 / 0		
Engr. Date	4/8/2014	Doc. Approved By	M. Campbell	Doc. Issued	6/8/2011		


# Motor Connection Diagrams <a href="mailto:12">12 Leads</a>

#### Across-the-Line Starting / Running Connections

Low Voltage Delta

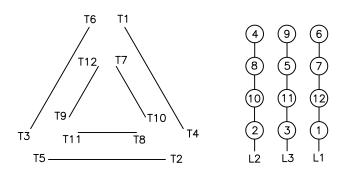

High Voltage Delta

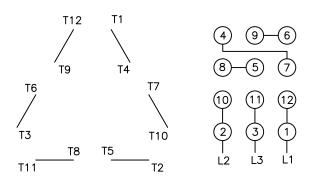

Switch L1 and L2 to reverse rotation

Suitable for Wye-Delta Starting and Limited Part-Winding-Starting. Please Contact Toshiba International for specific connections.

By: R. Murillo Date: 4/9/08 Checked: MDC Date: 5/17/11 Revision 1